HL3 Series Insert Manual



For complete installation instructions, see the Tube Heater General Manual that accompanies this Series Insert Manual.

RE-VERBER-RAY

The HL3 Series Infrared Tube Heater is a positive pressure, two-stage radiant heater system. This insert manual is a supplement to the Tube Heater General Manual and provides specific information related to the HL3 Series model. All persons involved with the installation, operation, and maintenance of the heater system must read and understand the information in this insert manual and the accompanying Tube Heater General Manual.

A WARNING



Improper installation, adjustment, alteration, service, or maintenance can cause property damage, injury, or death. Read the installation, operation, and maintenance instructions thoroughly before installing or servicing this equipment.

This heater must be installed and serviced by trained gas installation and service personnel only. Failure to comply could result in personal injury, asphyxiation, death, fire, or property damage.



In locations used for the storage of combustible materials, signs must be posted to specify the maximum permissible stacking height to maintain the required clearances from the heater to the combustibles. Signs must either be posted adjacent to the heater thermostats or, in the absence of such thermostats, in a conspicuous location.



Not for residential use! Do not use this heater in the home, sleeping quarters, attached garages, etc. Installation of a commercial tube heater system in residential indoor spaces may result in property damage, serious injury, asphyxiation, or death.

For Your Safety

If you smell gas:

- Do not try to light any appliance.
- Do not touch any electrical switch.
- Do not use any phone in your building.
- Immediately call your gas supplier from a neighbor's phone.
- Follow the gas supplier's instructions.
- If you cannot reach your gas supplier, call the fire department.

INSTALLER: Present this manual to the end user.							
Keep these instructions in a clean and dry place for future reference.							
Model#: Serial #:							
	(located on rating label)						

LIOHL3-Rev. 21314 Print: 3M-12/17 (CDS) Replaces: LIOHL3-3M-06/17(WHI)

Contents

1.0 Safe	ty	3
	Safety Labels and Their Locations	3
	Clearances to Combustibles	4
2.0 Inst	allation	6
	Gas Requirements	6
	Electrical Requirements	6
	Wiring	7
	Specifications	0
	Tube Installation Sequence	1
3.0 Ope	ration	2
	Sequence of Operation	2
	Thermostat	2
	Diagnostics	3
4.0 Tro	ıbleshooting Guide	4
5.0 Par	s1	8
	Burner Assembly Components	8
	Tube and Reflector Components	8
	Kit Contents Check List	0
	Approvals	0
	Limited Warranty	0

NOTE: See page 10 for a list of available models and specifications.

1.0 Safety


A WARNING




Improper installation, adjustment, alteration, service, or maintenance can cause property damage, serious injury, or death. Read and understand the installation, operating, and maintenance instruction thoroughly before installing or servicing this equipment. Only trained, qualified gas installation and service personnel may install or service this equipment.

Safety Labels and Their Locations

Product safety signs or labels should be replaced by the product user when they no longer are legible. Contact either your local distributor or the product manufacturer for obtaining replacement signs or labels.

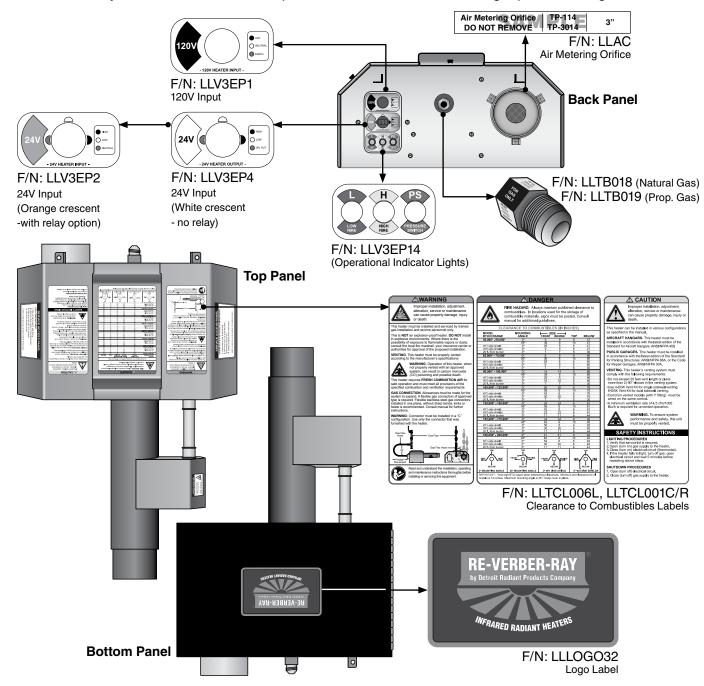

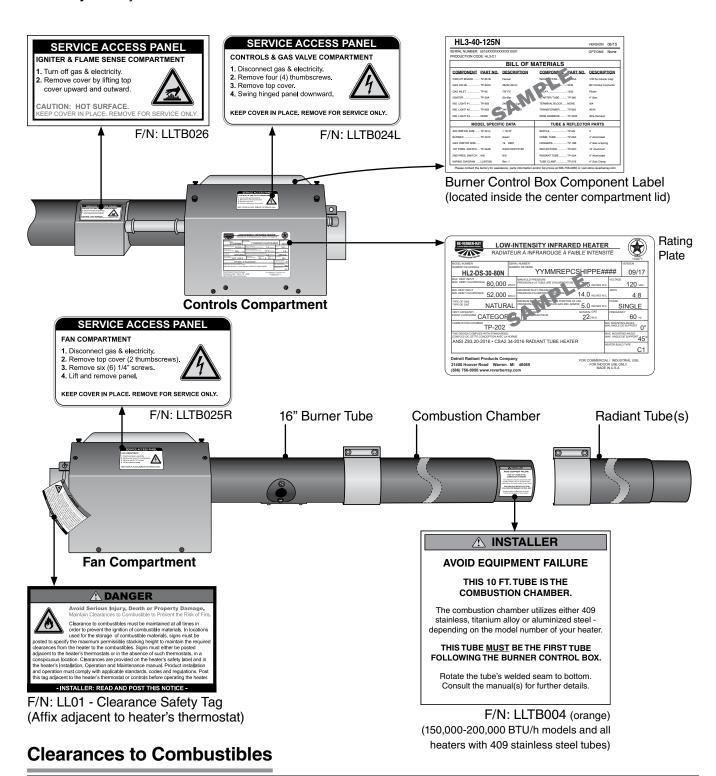

A WARNING





Placement of explosive objects, flammable objects, liquids, and vapors close to the heater may result in explosion, fire, property damage, serious injury, or death. Do not store or use explosive objects, liquids, or vapor in the vicinity of the heater.

Clearances to combustibles is defined as the minimum distance that must exist between the tube surface, or reflector, and any combustible items (see Figure 1.1). It also pertains to the distance that must be maintained from moving objects around the tube heater.

When installing the tube heater system, clearances to combustibles for the model tube heater and configuration must be maintained. Refer to Chart 1.1 below to determine the required distances for your model.


Chart 1.1 • Clearance to Combustibles in Inches (see Figure 1.1 for Mounting Angles)

	Mounting	Sid	Sides		
Model Number	Angle*	Front	Behind	Тор	Below
HL3 (20, 30, 40) - (65, 75) [N, P]	0°	9	9	6	60
	45°	39	8	10	60
with 1 side shield	0°	29	8	6	60
with 2 side shields	0°	9	9	6	60
20 ft. from burner	0°	7	7	6	30
HL3 (30, 40) - 100 [N, P]	0°	14	14	6	66
	45°	39	8	10	66
with 1 side shield	0°	29	8	6	66
with 2 side shields	0°	16	16	6	66
20 ft. from burner	0°	7	7	6	30
HL3 (30, 40, 50) - 125 [N, P]	0°	20	20	6	76
	45°	58	8	10	76
with 1 side shield	0°	42	8	6	76
with 2 side shields	0°	20	20	6	76
20 ft. from burner	0°	7	7	6	30
HL3 (40, 50, 60) - 150 [N, P]	0°	24	24	6	81
	45°	58	8	10	81
with 1 side shield	0°	42	8	6	81
with 2 side shields	0°	23	23	6	81
20 ft. from burner	0°	11	11	6	44
HL3 (40, 50, 60, 70) - 175 [N, P]	0°	34	34	6	92
	45°	63	8	10	92
with 1 side shield	0°	50	8	6	92
with 2 side shields	0°	30	30	6	92
20 ft. from burner	0°	11	11	6	44
HL3 (50, 60, 70) - 200 [N, P]	0°	41	41	6	94
	45°	63	8	10	94
with 1 side shield	0°	54	8	6	94
with 2 side shields	0°	30	30	6	94
20 ft. from burner	0°	11	11	6	44

^{*}Heaters mounted on an angle between 0° and 45° must maintain clearances posted for 0° or 45° ; whichever is greater.

The stated clearance to combustibles represents a surface temperature of 90°F (50°C) above room temperature. Building materials with a low heat tolerance (such as plastics, vinyl siding, canvas, tri-ply, etc.) may be subject to degradation at lower temperatures. It is the installer's responsibility to assure that adjacent materials are protected from degradation.

Figure 1.1 • Mounting Angles

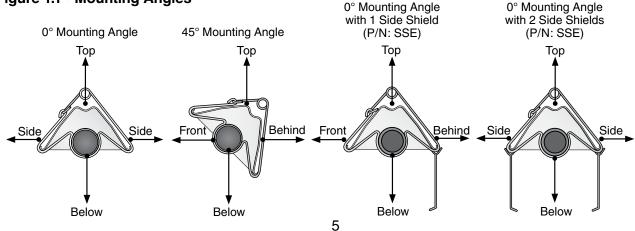

2.0 Installation

A WARNING



Improper installation, adjustment, alteration, service, or maintenance can cause property damage, serious injury, or death. Read and understand the installation, operating, and maintenance instructions thoroughly before installing or servicing this equipment. Only trained, qualified gas installation and service personnel may install or service this equipment.

Not for residential use! Do not use this heater in the home, sleeping quarters, attached garages, etc. Installation of a commercial tube heater system in residential indoor spaces may result in property damage, serious injury, or death.

Instructions for the following are detailed in the Tube Heater General Manual:

- Design considerations
- · Hanger suspension and placement
- Tube layout and assembly
- Burner control box suspension
- Reflectors (and accessories)
- Venting and combustion air intake
- Gas requirements
- Baffle assembly

Note: Electronic versions of all manuals are available at www.detroitradiant.com

Gas Requirements

Type of Gas	Type of Gas Required Manifold Pressure		Maximum Inlet Pressure		
Natural	3.5 Inches. W.C.	5.0 Inches. W.C.	14.0 Inches. W.C.		
Propane	10.0 Inches. W.C.	11.0 Inches. W.C.	14.0 Inches. W.C.		



IMPORTANT: Consult the Tube Heater General Manual for gas connection requirements.

Electrical Requirements

- 120VAC 60 Hz, GND, 3-wire
- 24VAC thermostat connection
- Starting current 4.8 amps
- Running current 1.1 amps

NOTICE

Connecting the thermostat with a voltage other than 24V may damage the heater. The HL3 Series requires a 24VAC connection to the thermostat. This is either supplied by the heater internally (standard) or by an external transformer (with optional isolation relays, P/N: HLRP). See Figure 2.1A-B.

NOTE: A yellow control cord replaces the external terminal plug on stainless steel models and models with water resistant upgrades.

Wiring


A WARNING




Electric Shock

Field wiring to the tube heater must be connected and grounded in accordance with national, state, provincial, local codes, and to the guidelines in the Tube Heater General Manual and Series Insert Manual. In the United States refer to the most current revisions to the ANSI/NFPA 70 Standard and in Canada refer to the most current revisions to the CSA C22.1 Part I Standard.

Figure 2.1 • Field Wiring Diagrams

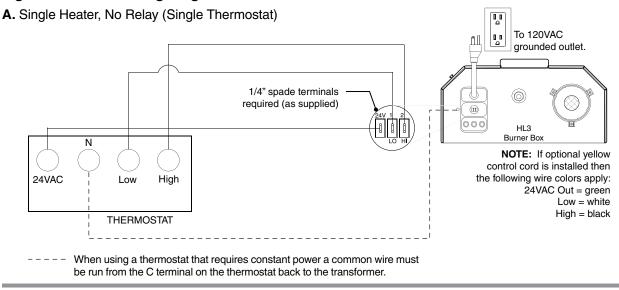

B. Multiple Heaters with Relay Option (Single Thermostat)

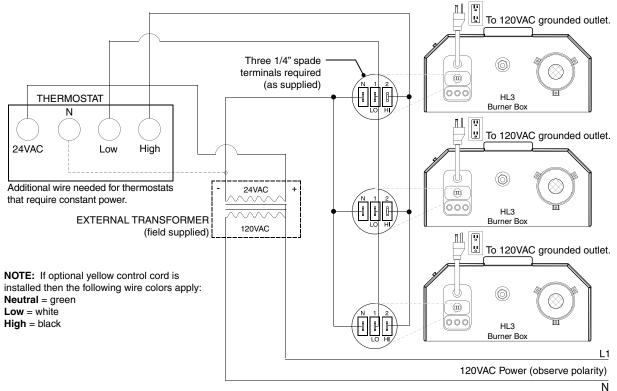


2.0 Installation • Wiring


Before field wiring this appliance - Check existing wiring; replace if necessary.

Note: If any of the original wire supplied with the appliance must be replaced, it must be replaced with wiring material having a temperature rating of at least 105° C.

Figure 2.2 • Internal Wiring Diagrams

A. 35-66 Ladder Diagram

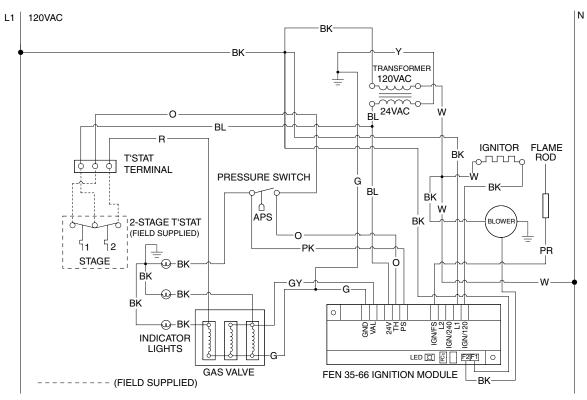


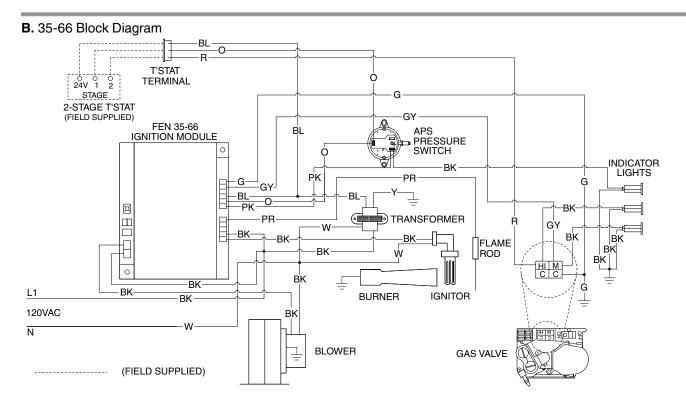


HL3 Series 2.0 Installation • Wiring

Figure 2.3 • Alternative Wiring Diagrams

A. 35-66 Ladder Diagram - With HLRP Relay

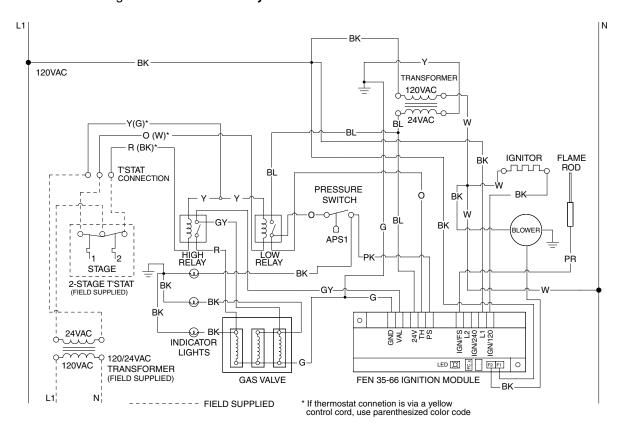

B. 35-66 Block Diagram - With HLRP Relay

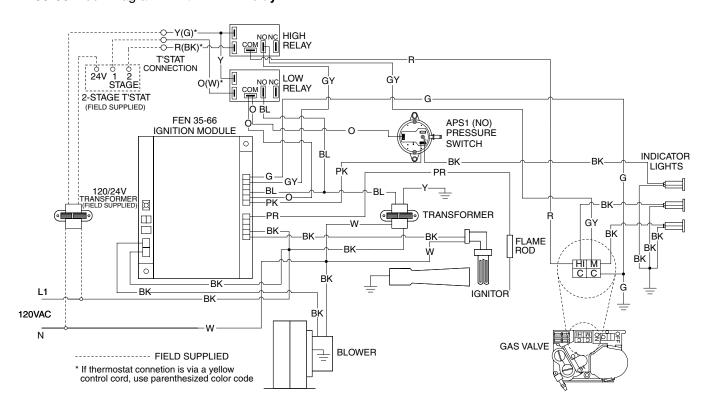

Specifications

Chart 2.1 • Specifications

Model Number	Gas Type (select one)	BTU/h (High Fire)	BTU/h (Low Fire)	Straight Length	U-Tube Length	Standard Weight (Ibs.)	Stainless Steel Weight (Ibs.)	Recommended Mounting Height^	Combustion Chamber (Black Coated)	Radiant Emitter Tube(s) (Black Coated)	36" Baffle Quantity
HL3-20-65	Nat. or Prop.	65,000	50,000	21'-9"	13'-1"	120	N/A	9' to 14'	Alum	Alum	5
HL3-20-75	Nat. or Prop.	75,000	50,000	21'-9"	13'-1"	120	145	10' to 15'	Alum	Alum	5
HL3-30-65	Nat. or Prop.	65,000	50,000	31'-5"	**17'-9"	160	N/A	10' to 15'	Alum	Alum	4
HL3-30-75	Nat. or Prop.	75,000	50,000	31'-5"	**17'-9"	160	195	11' to 18'	Alum	Alum	5
HL3-30-100	Nat. or Prop.	100,000	65,000	31'-5"	**17'-9"	160	195	12' to 20'	Alum	Alum	5
HL3-30-125	Nat. or Prop.	125,000	82,000	31'-5"	**17'-9"	160	195	13' to 23'	Alum	Alum	6
HL3-40-65	Nat. or Prop.	65,000	50,000	41'-1"	22'-9"	190	N/A	11' to 18'	Alum	Alum	3
HL3-40-75	Nat. or Prop.	75,000	50,000	41'-1"	22'-9"	190	235	11' to 18'	Alum	Alum	4
HL3-40-100	Nat. or Prop.	100,000	65,000	41'-1"	22'-9"	190	235	12' to 20'	Alum	Alum	4
HL3-40-125	Nat. or Prop.	125,000	82,000	41'-1"	22'-9"	190	235	13' to 23'	Alum	Alum	5
HL3-40-150*	Nat. or Prop.	150,000	100,000	41'-1"	22'-9"	190	235	14' to 25'	Titan	Alum	5
HL3-40-175*	Nat. or Prop.	175,000	125,000	41'-1"	22'-9"	190	235	15' to 27'	Titan	Alum	5
HL3-50-125	Nat. or Prop.	125,000	82,000	50'-9"	**27'-5"	235	290	15' to 27'	Alum	Alum	3
HL3-50-150*	Nat. or Prop.	150,000	100,000	50'-9"	**27'-5"	235	290	15' to 27'	Titan	Alum	3
HL3-50-175*	Nat. or Prop.	175,000	125,000	50'-9"	**27'-5"	235	N/A	16' to 30'	Titan	Alum	3
HL3-50-200*	Nat. or Prop.	200,000	145,000	50'-9"	**27'-5"	235	N/A	17' to 35'	Titan	Alum	2
HL3-60-150*	Nat. or Prop.	150,000	100,000	60'-5"	32'-5"	265	330	16' to 30'	Titan	Alum	2
HL3-60-175*	Nat. or Prop.	175,000	125,000	60'-5"	32'-5"	265	N/A	16' to 30'	Titan	Alum	2
HL3-60-200*	Nat. or Prop.	200,000	145,000	60'-5"	32'-5"	265	N/A	17' to 35'	Titan	Alum	2
HL3-70-175*	Nat. or Prop.	175,000	125,000	70'-1"	**37'-3"	300	N/A	19' to 42'	Titan	Alum	2
HL3-70-200*	Nat. or Prop.	200,000	145,000	70'-1"	**37'-3"	300	N/A	19' to 42'	Titan	Alum	2

^{*} Model requires stainless steel tube clamp (P/N: TP-220) to be located at the seam between the primary combustion chamber and the secondary combustion tube downstream of the burner control box.

IMPORTANT: Reference box label to determine the number of required baffle sections for each model heater.

Alum = Black coated aluminized treated steel.

Titan = Black coated titanium stabilized aluminized steel.


^{**} Model requires 5EA-SUB accessory package when installing in a 'U' configuration (P/N: TF1B).


[^] Factory recommended mounting heights are listed as a guideline.

Tube Installation Sequence

Figure 2.4 • Tube Installation Sequence

Important! The combustion chamber & radiant tube sections must be installed in the following order.

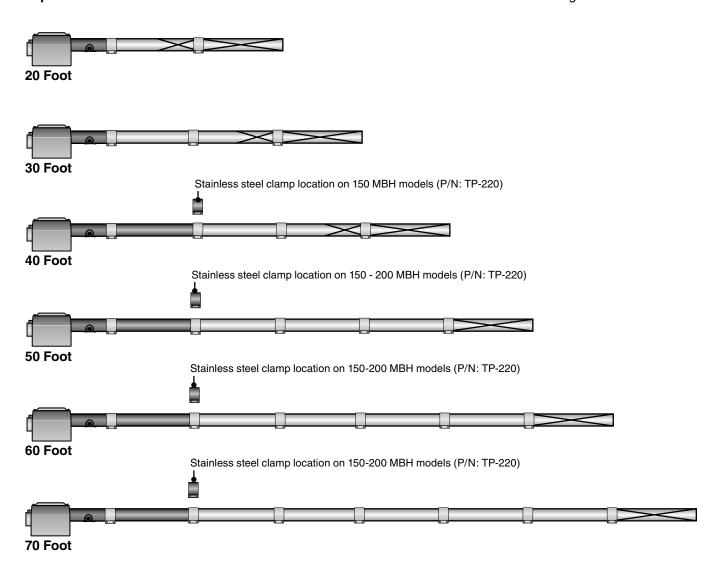

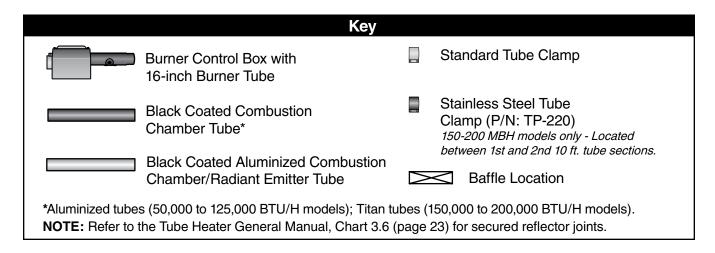

3.0 Operation

A WARNING



This heater must be installed and serviced by trained gas installation and service personnel only.

Do not bypass any safety features or the heater's built in safety mechanisms will be compromised.

Note: Reference the Tube Heater General Manual for installation requirements.

Sequence of Operation

Standby: The 35-66 control continually checks for internal faults, circuit integrity, and relay contact positioning.

Starting Circuit: Upon a call for heat, the control verifies that the differential switch is in the proper position (open). The control energizes the fan. Once operational static pressure is achieved, the differential switch will close initiating the ignition sequence. The glo-bar is powered and the gas valve opens after 45 seconds. If the flame is not sensed, the heater will attempt to re-ignite for a total of three (3) trials for ignition before proceeding to soft lockout.

Single Stage Running Circuit: After ignition, the flame rod monitors burner flame. If sense of flame is lost, the control closes the gas valve within one second and a new trial sequence (identical to the starting sequence) is initiated. If flame sense is not established within 8.5 seconds, the heater will attempt two (2) additional ignition sequences before proceeding to soft lockout. The control can be reset by briefly interrupting the power source.

Two Stage Running Circuit: The second stage on the gas valve is powered directly from the second stage of the thermostat. In order for two stage to flow to a higher output, single stage must be energized as well. The thermostat determines which stage to maintain for the desired temperature.

Shut Down: When the thermostat is satisfied, the fan will enter a two (2) minute post-purge cycle. Refer to Soft and Hard Lockout under Diagnostics on page 13.

Thermostat

HL3 Series heaters require a 24VAC, two-stage thermostat to operate. The burner control box is equipped with a round terminal strip that accepts three (3) 1/4" insulated female spade terminals. Do not supply 120V to the 24V connection.

The HL3 Series is equipped with or without relays (P/N: HLRP). The optional relays must be factory installed. **NOTE:** Units with a relay installed must have an external transformer (field supplied), see wiring diagram (Figure 2.2B).

Standard Configuration


Without relays (identified with white label around the terminal block):


- Single burner control box
- Single thermostat

Optional Configuration

With relays (identified with orange label around the terminal block):

- A single thermostat controls two or more burner control boxes.
- Heaters are common vented
- Must be factory installed





Diagnostics

Lockout:

The controls will automatically lockout the heater system when an external or system fault occurs. There are two types of lockout:

Soft Lockout: The heater will attempt to light three times. In the event of a failed attempt to light, (gas pressure, valve, no flame sense etc.), the heater will enter a soft lockout period for 15 minutes and then attempt to light three more times before entering Hard Lockout mode.

Hard Lockout: If proof of flame is not established, a component failure occurs or blockages are evident, the heater will enter hard lockout. If lockout occurs, the control can be reset by briefly interrupting the power source. Refer to Chart 3.1 and 3.2 below for a description of LED codes.

Figure 3.1 • Operational Indicator Lights

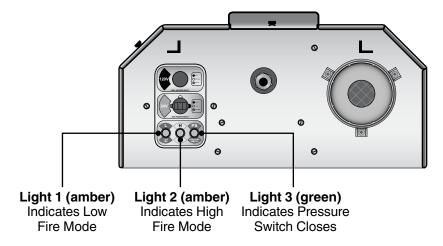


Chart 3.1 • LED Diagnostic Codes - Fenwal **Circuit Board**


LED Code	Fault Status	Fault Code Delay*
Initial flash on power	No fault,	No delay
up, then steady off	normal operation	
Steady on	Module failure / Internal fault	No delay
1 flash	Ignition failure	3 minutes
2 flashes	APS (Air Proving Switch)	0-30
2 liasiles	(Fan/Intake/Exhaust)	seconds
3 flashes	Lockout	17 minutes
	Solenoid valve fault	
4 flashes	Leaky valve	No delay
	Flame amplifier fault	
No flash on 117V	Transformer fault	No delay
startup		110 delay

Chart 3.2 • LED Diagnostic Codes - Capable **Controls Circuit Board**

LED Code	Fault Status	Fault Code Delay*
Initial flash (Red) on power up	Normal operation	Immediate
Steady flash (Green) during ignition	Normal operation	Immediate
Steady on (Green) after flame sense	Normal operation	1 minute
1 flash (Red)	Ignition failure	3 minutes
1 flash (Red)	Reverse Polarity	30 Seconds
2 flashes (Red)	Ignition error	12 seconds
3 flashes (Red)	Gas valve error	
4 flashes (Red)	Line voltage frq. error	
5 flashes (Red)	Internal control error	
6 flashes (Red)	Pressure switch error	

^{*}Some LED codes have a time delay before the LED will flash.

4.0 Troubleshooting Guide

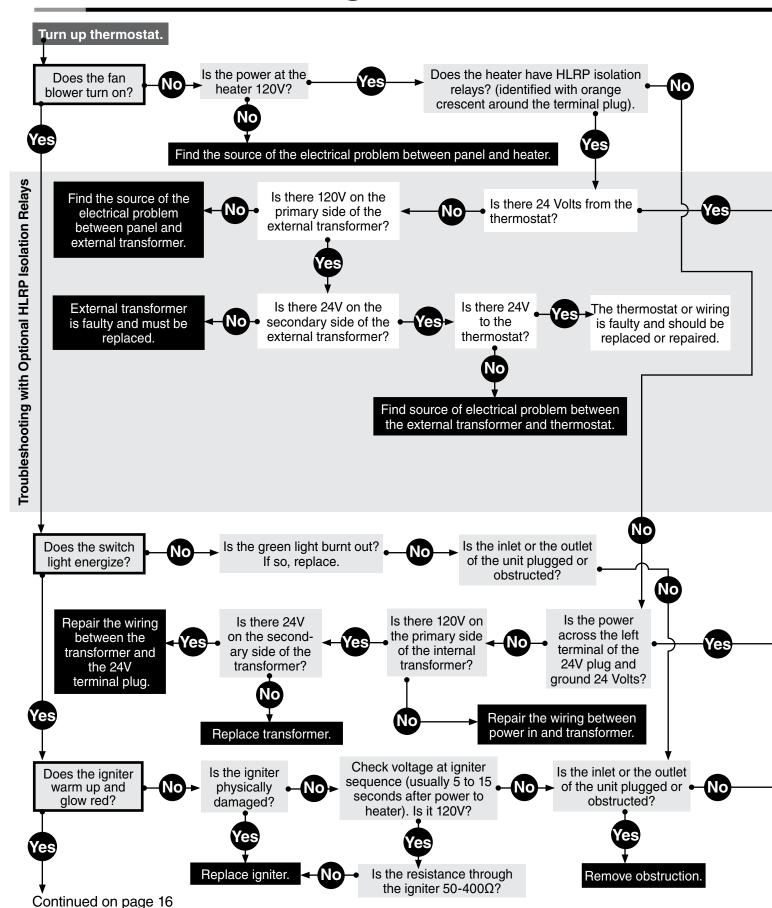

NOTICE

Bypassing any switch is intended for testing purposes only. Do not leave switch bypassed during normal operation or the heater's built-in safety mechanisms will be compromised.


Key With HLRP Isolation Relays: Without HLRP Isolation Relays: **Process** Corrective **Process** Corrective Start Question Question Action Question Action Is the power across Is the circuit Is the power across the t-stat wire on the board sending. Is the fan Remove the 24V wire on the circuit board and 120V to the obstructed? obstruction. circuit board and ground 24V? fan? ground 24V? Replace Is the pressure The relay board is faulty switch. switch stuck in the and must be replaced. closed position? Is there 120V on the The internal primary side of the transformer is internal transformer? faulty and must be replaced. The circuit board is faulty and must be replaced. Repair wiring between power in and transformer. The fan is faulty and must be replaced. Nο Is the pressure switch stuck Replace pressure in the closed position? Is the power across switch the middle (low) Is there 24V terminal of 24V plug Is the circuit across the TH and and ground (screw ground terminals board sending Remove on the Burner Control Is the fan 120V to the on the circuit obstruction. Box) 24 Volts? obstructed? fan? board? Replace the pressure switch after verifying: Repair thermostat or wiring from Baffle(s) are in the radiant tube furthest from thermostat to heater. Correct wiring. the burner. Heater, fan blowers ,squirrel cage, intake and Check for loose wiring or *After 0-30 seconds of exhaust are clean and free from dirt and restrictions in hose connecnon-operation has passed, tions to pressure switch. is there a flash code for obstructions. Are they OK? APS failure (2 flashes)? The 4" air intake pipe does not exceed 20 ft. and/or 2 elbows. There is not a negative pressure experienced at the area of air intake (e.g.; high winds, attic


Replace wiring or hose connections.


space, tightly sealed building).

Replace circuit board.

^{*} Refer to LED diagnostic Fault Code Chart; p.13.

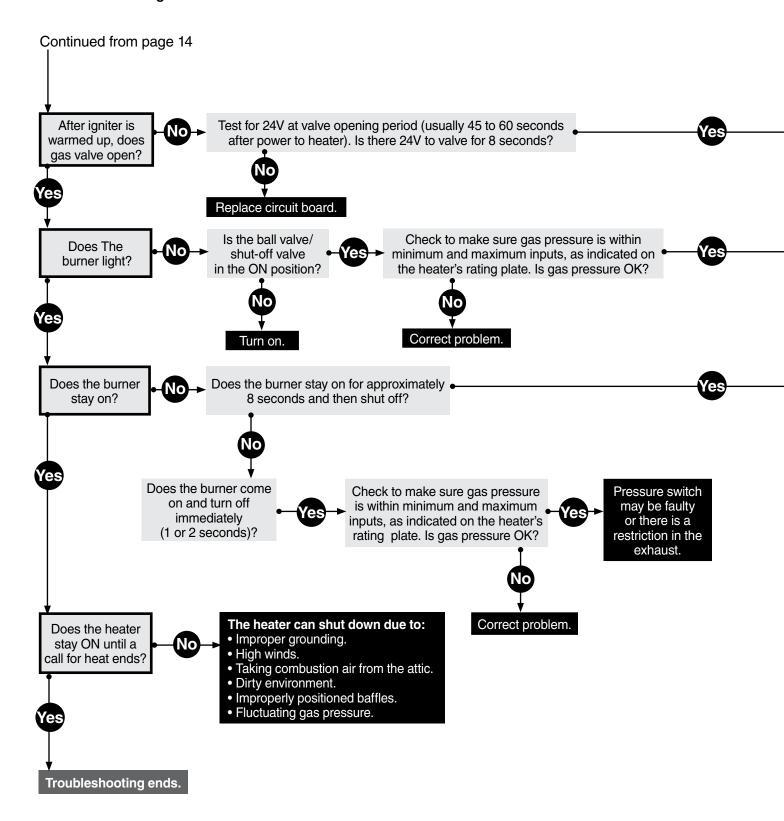


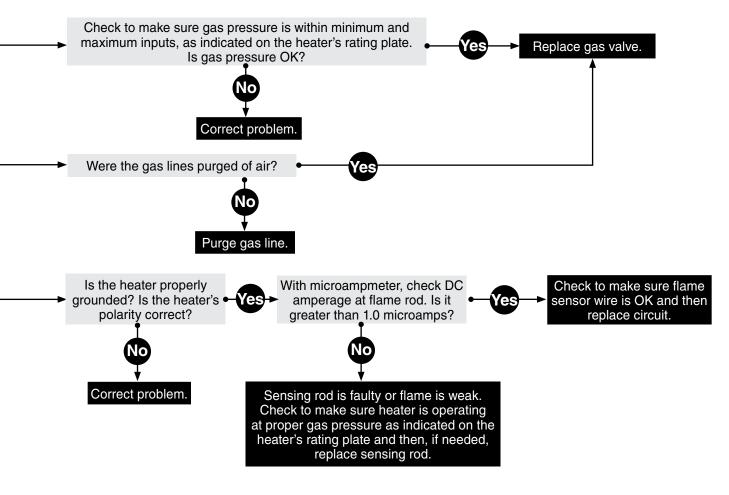

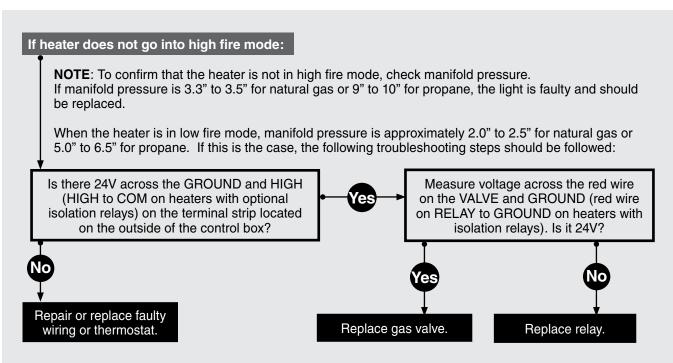

5.0 Parts

Figure 5.1 • Burner Assembly Components

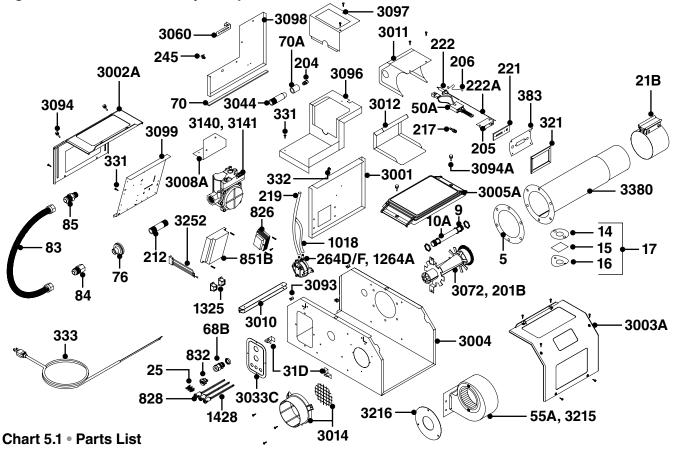

Part #	Description	Part #	Description
TP-5	Flange Gasket	TP-70	1/2 in. Control Box Gasket (10.3 inches)
TP-9	Conduit Coupling	TP-70A	1 in. Control Box Gasket (6 inches)
TP-10A	Conduit 4" x 3/4"	TP-76	Rubber Grommet
TP-14	Sight Glass Gasket	TP-82	Reflector Center Support (RCS)
TP-15	Sight Glass	TP-83	24 in. Stainless Steel Flexible Gas Connector
TP-16	Sight Glass Washer	TP-84	1/2 in. Female / Male Flare Fitting
TP-17	Sight Glass Kit	TP-85	1/2 in. Male / Male Flare Fitting
TP-19B	4 in. Wire Hanger with Tension Spring	TP-105	Aluminum Reflector End Cap
TP-20C	120 in. Aluminum Reflector	TP-106	Reflector End Cap Clips (8 pcs.)
TP-20D*	120 in. Stainless Steel Reflector	TP-113	Reflector Tension Spring
TP-21B	4 in. Standard Tube Clamp	TP-201B	V.3 Mid-High Burner (Color Code - TAN)
TP-25	1/4 in. Female Spade Terminal (Qty. 3)	TP-204	Gas Orifice (consult factory)
TP-26A	10 ft. Aluminized Radiant / Combustion Tube	TP-205	Glo-Bar™ Holder
TP-26B	10 ft. Titanium Coated Combustion Tube	TP-206	Glo-Bar™ Holder Spring Clip
TP-26D*	10 ft. 304 Stainless Steel Radiant Tube	TP-212	1/2" x 3" Pipe Nipple
TP-26E*	10 ft. 409 Stainless Steel Combustion Tube	TP-217	Brass Pressure Switch Barb Fitting
TP-31D	Interlocking Mounting Bracket (Qty. 2)	TP-219	Differential Vinyl Sensing Tube (burner)
TP-50A	Glo-Bar™ Igniter	TP-220	Stainless Steel Tube Clamp (150 & 200 MBH)
TP-55A	1/20 hp Inducer Assembly (50-150 MBH)	TP-221	Glo-Bar™ Holder Gasket
TP-65I	36 in. Interlocking Turbulator Baffle	TP-222	Flame Rod
TP-68B	Large Strain Relief Bushing	TP-222A	Flame Rod Wire

^{*} Optional upgrade or add-on item.

Figure 5.2 • Tube and Reflector Components 105 20C/D* 106 82 105 26A/D* 26A/B/E* 21B, 220 65I

Chart 5.2 • Parts List

Part #	Description	Part #	Description
TP-245	3/16" X 1/8" Plastic Gas Valve 90° Vent	TP-3008A	Gas Valve Mounting Bracket
TP-264D	Differential Pressure Switch, 65 to 75 MBH	TP-3010	Service Panel Hinge
TP-264F	Differential Pressure Switch, 150 to 200 MBH	TP-3011	V.3 Igniter Box
TP-321	Ignition Plate Gasket	TP-3012	V.3 Igniter Box Cover
TP-331	Green Self-Tap Ground Screw (Qty. 2)	TP-3014	Plastic Air Orifice with Screen
TP-332	Divider Grommet	TP-3033C	HL3 Power Entry Plate
TP-333	60 in. Black 120V Power Cord with Ground	TP-3044	Gas Manifold
TP-383	Glo-Bar™ Igniter Plate	TP-3060	V.3 Pressure Switch Mounting Bracket
TP-579	4 in. Wire Hanger w/o Tension Spring	TP-3072	Low BTU Burner (Color Code - GREEN)
TP-826	40VA Transformer	TP-3093	#8-23 Cage Nut (Qty. 4)
TP-828	24V Yellow Operational Indicator Light (Qty. 2)	TP-3094A	#8-32 x ½" Zinc Coated Steel Knurled Thumb
TP-832	Thermostat Terminal Strip		Screw (Qty. 4)
TP-851B	35-66 Diagnostic Circuit Board	TP-3096	Valve Compartment Bottom Panel
TP-1018	Differential Switch Vinyl Sensing Tube (exhaust)	TP-3097	Valve Compartment Top Panel
TP-1264A	Differential Pressure Switch, 100 to 125 MBH	TP-3098	Valve Compartment Side Panel
TP-1325	Optional HLRP Isolation Relay* (Qty. 2)	TP-3099	Controls Mounting Panel
TP-1428	24V Green Operational Indicator Light	TP-3140	36G54-224 Gas Valve - Natural Gas Assembly
TP-3001	Divider Panel	TP-3141	36G54-226 Gas Valve - Prop. Gas Assembly
TP-3002A	Plastic End Panel, Control Compartment	TP-3215	1/15 hp Inducer Assembly (175-200 MBH)
TP-3003A	Plastic End Panel, Fan Compartment	TP-3216	Reducer Plate (175-200 MBH)
TP-3004	V.3 Control Box	TP-3252	4-Piece Wire Harness Set
TP-3005A	Plastic Valve Chamber Lid	TP-3380	V.3 16" HSI Burner Tube w/ Flange and Fittings

^{*} Optional upgrade or add-on item.

Kit Contents Check List

Chart 5.3 • Kit Contents for HL3 Series - Reference the length column for your model.

			<u> </u>		•				
HL3 Series Kit Contents									
1		TP-82 4" Reflecto Center Support (RC		TP-105 Reflector End Cap		TP-10 Reflect End Cap	tor	TP-25 1/4" Female Spade Terminal	
	**TP-19C	**TF	P-829		**TP-105A				
	Stainless Steel	TP-21B 4" Tube Cl	amp	LIOGT3 Gen	eral Manual	LIOHL	3 HL3	Series Insert	
Flexible Gas Connector **TP-83A		**TF	P-220	Tube Heater General Manual			HL3 Series Insert Mann A MARKON A	The second of th	
Part No.	Description		20 ft.	. 30 ft.	40 ft.	50 ft.	60 f	t. 70 ft.	
TP-19B	4" Hanger w/ T	ension Spring	3	4	5	6	7	8	
TP-21B	4" Tube Clamp		2	3	4*	5*	6*	7*	
TP-25	1/4" Female Sp	ade Terminal	3	3	3	3	3	3	
TP-82	4" Reflector Center Support		2	3	4	5	6	7	
TP-83	24" S.S. Flexible Gas Connector		1	1	1	1	1	1	
TP-105	Reflector End (Cap	2	2	2	2	2	2	
TP-106	Reflector End (Cap Clips	8	8	8	8	8	8	
1	\								

V3 General Tube Heater Manual

HL3 Series Insert Manual

Approvals

LIOGT3

LIOHL3

Filled By:

- CSA
- Indoor Approval
- Outdoor Approval with OD-Kit
- Commercial Approval

Limited Warranty

- 1 year Burner box components
- 5 years Combustion and radiant tubes
- 10 years Stainless steel burner
- See page 36 of the General Tube Heater Manual for terms and conditions



© 2017 Detroit Radiant Products Co. 21400 Hoover Road • Warren, MI 48089 Phone: (586) 756-0950 Fax: (586) 756-2626 www.detroitradiant.com • sales@drp-co.com



1 1

NOTE: One 4" stainless steel tube clamp (P/N: TP-220) is provided for each 150,000 - 200,000 BTU/h model. Place as shown on page 11.

^{**} Part number for models upgraded with stainless steel options.